





THE FRAME SHALL BE SECURELY FASTENED TO THE TOP MANHOLE SECTION BY FOUR 3/4-INCH STAINLESS STEEL CINCH ANCHORS

(2) 1/2" DIA. HOLES DRILLED AND TAPPED INTO FRAME LIP. AM. STD. THREAD 13/IN.

(4) ONE INCH HOLES

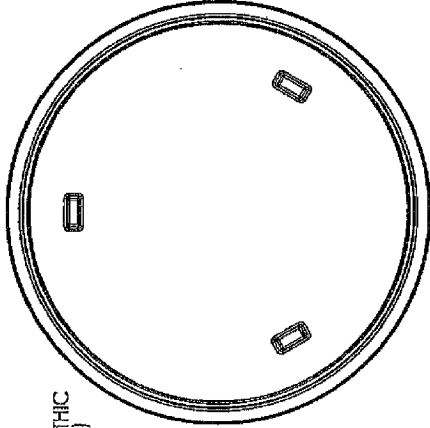

BOTTOM VIEW

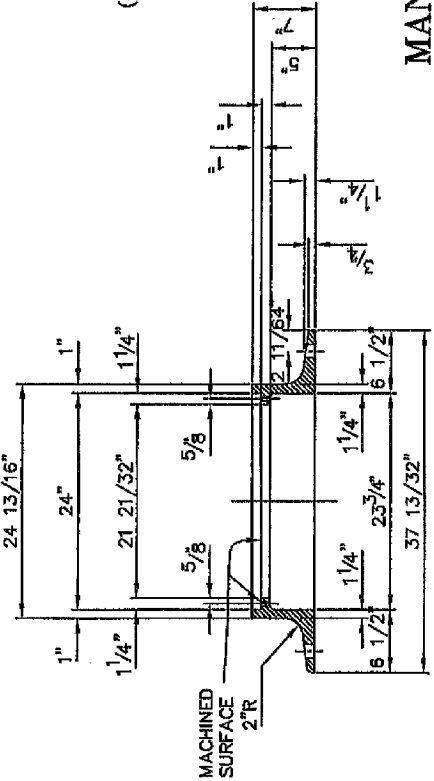

CITY OF CINCINNATI
 METROPOLITAN SEWER DISTRICT
 STORMWATER MANAGEMENT UTILITY

**STANDARD CASTING FOR
 MANHOLES IN SIDEWALK AREAS**

NO SCALE
 APPROVED *M. J. Stanger*
 September, 2011
 SMU CHIEF ENGINEER

East Jordan 166550 or approved equal

ACC. NO. 120335