


SECTION A-A

SECTION B-B

NOTES

- CONCRETE SLAB MAY BE PRECAST WITH LIFT HOLES 12" FROM EACH END. MARK TOP OF SLAB.
- FOR PAVEMENT DETAIL SEE Acc. No. 49018.
- INLET CHAMBER SHALL BE BUILT OF CONCRETE IN ACCORDANCE WITH 604 OR PRECAST, USING REINFORCING STEEL CHART. Acc. No. 49010.
- FOR SETTING OF INLET BOX AND CASTING SEE Acc. No. 49015.
- PIPES SHALL NOT ENTER WITHIN 8" OF CORNER.
- FOR STANDARD CASTINGS SEE Acc. No. 49014.
- ALL BARS SHALL CLEAR INTERIOR FACE OF WALL BY 2". BOX LENGTHS SHALL BE 5'-10" FOR THE LONGER SIDE AND 4'-7" FOR THE SHORTER SIDE. VERTICAL REINFORCING BARS SHALL BE #5 AND PLACE 22" O.C. FOUR OF THESE BARS SHALL BE LOCATED AT THE CORNERS OF THE CHAMBER.
- * UNLESS OTHERWISE APPROVED.

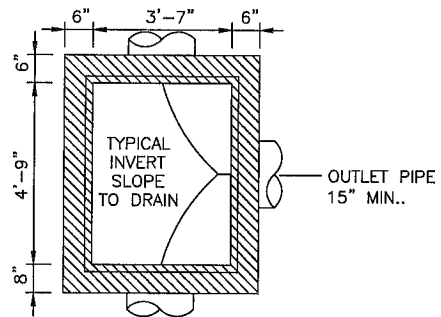

SECTION C-C

WALL HORIZONTAL REINFORCING STEEL	
DEPTH	BAR SPACING
4' TO 8'	#5 @ 16"
8' TO 12'	#5 @ 12"
12' TO 16'	#5 @ 8"

CITY OF CINCINNATI
METROPOLITAN SEWER DISTRICT
STORMWATER MANAGEMENT UTILITY

**STANDARD
COMBINATION INLET M.H.
PLAN C.I.M.H.**

NO SCALE
APPROVED  AUGUST, 2014
SMU CHIEF ENGINEER

A.D.J.

ACC. NO. 49041