


- NOTES**
- ① ROMAC PART # 511-3.50 X 3.50 X 7SSPE WITH NBR GASKETS
 - ② 3" x 32" PIPE (ONE END THREADED)
 - ③ 3" X 3" X 3" THREADED TEE (150psi)
 - ④ 3" x 7-1/4" PIPE (BOTH ENDS THREADED)
 - ⑤ 3" S.S. STREAM FLOW BALL VALVE MODEL BV150SS3FP S.S. FULL PORT S.S. BALL VALVE THREADED HANDLE CUT TO FIT MAXIMUM CLEARANCE 1" REMOVE LATCH LOCK
 - ⑥ 3" x 4" NIPPLE (BOTH ENDS THREADED)
 - ⑦ 3" to 2" BUSHING
 - ⑧ 2" x 3" NIPPLE (BOTH ENDS THREADED)
 - ⑨ AIR RELIEF VALVE ~~AP00-115.1 OR 115.1~~ (AS REQUIRED) SANDBLASTED AND COATED COAL TAR EPOXY C-200 SHERWIN WILLIAMS OR EQUAL
 - ⑩ 1" X CLOSE S. S. NIPPLE
 - ⑪ 1" FULL PORT S.S. BALL VALVE
 - ⑫ 2" S.S. STREAM FLOW BALL VALVE MODEL BV150SS3FP S.S. FULL PORT S.S. BALL VALVE THREADED HANDLE MODIFIED (SEE HANDLE DETAIL) MAXIMUM CLEARANCE 1" REMOVE LATCH LOCK
 - ⑬ 3" S.S. PIPE PLUG
 - ⑭ S.S. STREET 90 ~~AP00-115.1 REQUIRED~~ ~~AP00-115.1 REQUIRED - 3"~~

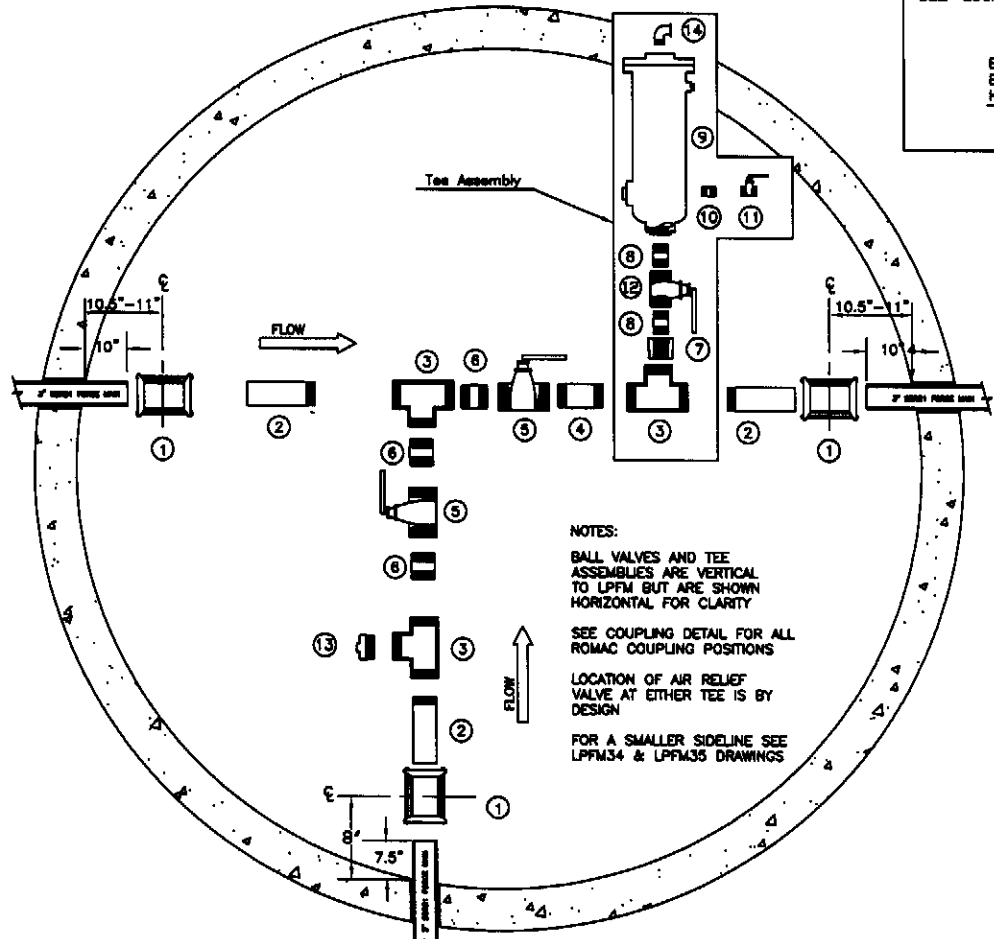

Air Release Valves shall be Vent-Tech or Vent-O-Mat.

Air Release Valves shall be Vent-Tech or Vent-O-Mat.

GENERAL NOTES:

• ALL MATERIALS MUST BE 304 STAINLESS STEEL SCHEDULE 40 (EXCEPT AS NOTED)

EXPLODED TOP VIEW
NOT TO SCALE

THE METROPOLITAN SEWER DISTRICT OF GREATER CINCINNATI
3" LOW PRESSURE FORCE MAIN RIGHT TEE AIR RELIEF CHAMBER DETAIL